




www.phd-mfg.com

# SEISMIC BRACING

**FIG. 045**

## SWAY BRACE STRUCTURAL ADAPTER

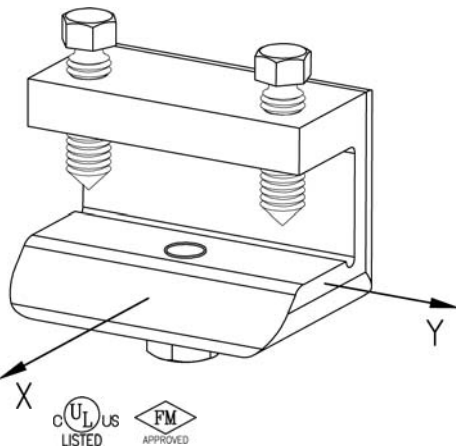

**Function:** Sway brace adapter used to attach a PHD Manufacturing sway brace assembly to a steel structural member of  $\frac{3}{8}$ " minimum and  $1\frac{1}{4}$ " maximum thickness. To provide a point of connection when drilling or welding is not allowed or not practical. Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer's installation instructions.

**Size:** Braces up to 8" Pipe MAX. Attaches to  $\frac{3}{8}$ " MINIMUM and  $1\frac{1}{4}$ " MAX thick structural members. When attaching to a structure less than  $\frac{3}{8}$ " thick, please see PHD Manufacturing Fig. 035.

**Material:** Ductile iron

**Finish:** Electro-galvanized

**Install:** Place on structural member with the flange contacting the back of the jaw. Tighten set screws finger tight, then evenly tighten until hex heads break off. Attach PHD structural attachment to Fig. 045 with the supplied attachment bolt, ensuring that the attachment bolt head bottoms out securely. Please note that the maximum load will be limited by the PHD Manufacturing structural attachment utilized with this adapter.

**Approvals:** Underwriters Laboratories listed for US and Canada and Factory Mutual approved. Listed for use with NFPA fastener tables and PHD sway brace components only.

**Ordering:** Specify figure number.

UL Maximum Design Load					
Pipe Size		lbs.	kN	Wt. Each	
				lbs.	kg
8" MAX	(200)	2015	(8.96)	3.49	(1.58)

FM Maximum Design Load					
Beam Flange Thickness	Brace Angle From Vertical (Degrees)	X		Y	
		lbs.	kN	lbs.	kN
$\frac{3}{8}$ " MIN - $1\frac{1}{4}$ " MAX	30°-44°	1150	(5.11)	900	(4.00)
	45°-59°	1800	(8.00)	1050	(4.67)
	60°-74°	2230	(9.91)	1260	(5.60)
	75°-90°	2460	(10.94)	1410	(6.27)

THREADED ACCESSORIES  
CPVC STRAPS  
BAND HANGERS  
BEAM CLAMPS  
CLEVIS HANGERS  
PIPE ROLLER SUPPORTS  
SPLIT RING HANGERS  
PIPE CLAMPS  
CENTER LOAD BEAM CLAMPS  
PIPE SHIELDS, INSULATION, & SADDLES  
PIPE GUIDES & SLIDES  
WALL BRACKETS  
PIPE SUPPORTS  
STRUCTURAL ATTACHMENTS  
SEISMIC BRACING



**PHD Manufacturing, Inc.**


44018 Columbiana-Waterford Road  
 Columbiana, Ohio 44408-9481  
 Phone: 800-321-2736 • 330-482-9256  
 Fax: 330-482-2763  
 Web: www.phd-mfg.com

**FIG. 045 SWAY BRACE STRUCTURAL ADAPTER**

- Pipe Braced:** 8" Pipe MAX
- Function:** Sway brace adapter used to attach a PHD Manufacturing sway brace assembly to a steel structural member of 3/8" minimum and 1 1/4" maximum thickness. To provide a point of connection when drilling or welding is not allowed or not practical. Sway brace assemblies are intended to be installed in accordance with NFPA 13 and the manufacturer's installation instructions.
- Approvals:** Underwriters Laboratories listed for US and Canada  
 Factory Mutual approved  
 Listed for use with NFPA fastener tables and PHD sway brace components only
- Material:** Ductile Iron
- Installation:** Place on structural member with the flange contacting the back of the jaw. Tighten set screws finger tight, then evenly tighten until hex heads break off. Attach PHD structural attachment to Fig. 045 with the supplied attachment bolt, ensuring that the attachment bolt head bottoms out securely. Please note that the maximum load will be limited by the PHD Manufacturing structural attachment utilized with this adapter.

UL Maximum Design Load	
Pipe Size	lbs.
8" MAX	2015

FM Maximum Design Load			
Beam Flange Thickness	Brace Angle From Vertical (Degrees)	X	Y
		lbs.	lbs.
3/8" Min. 1 1/4" Max.	30°-44°	1150	900
	45°-59°	1800	1050
	60°-74°	2230	1260
	75°-90°	2460	1410



*The Complete Line of Pipe Supports and Devices*  
 Pipe Hangers ▲ Strut & Accessories ▲ Pipe Clamps ▲ Beam Clamps ▲ Shields